


QUARTERLY BACTERIOLOGICAL SAMPLING FOR WATER SYSTEMS

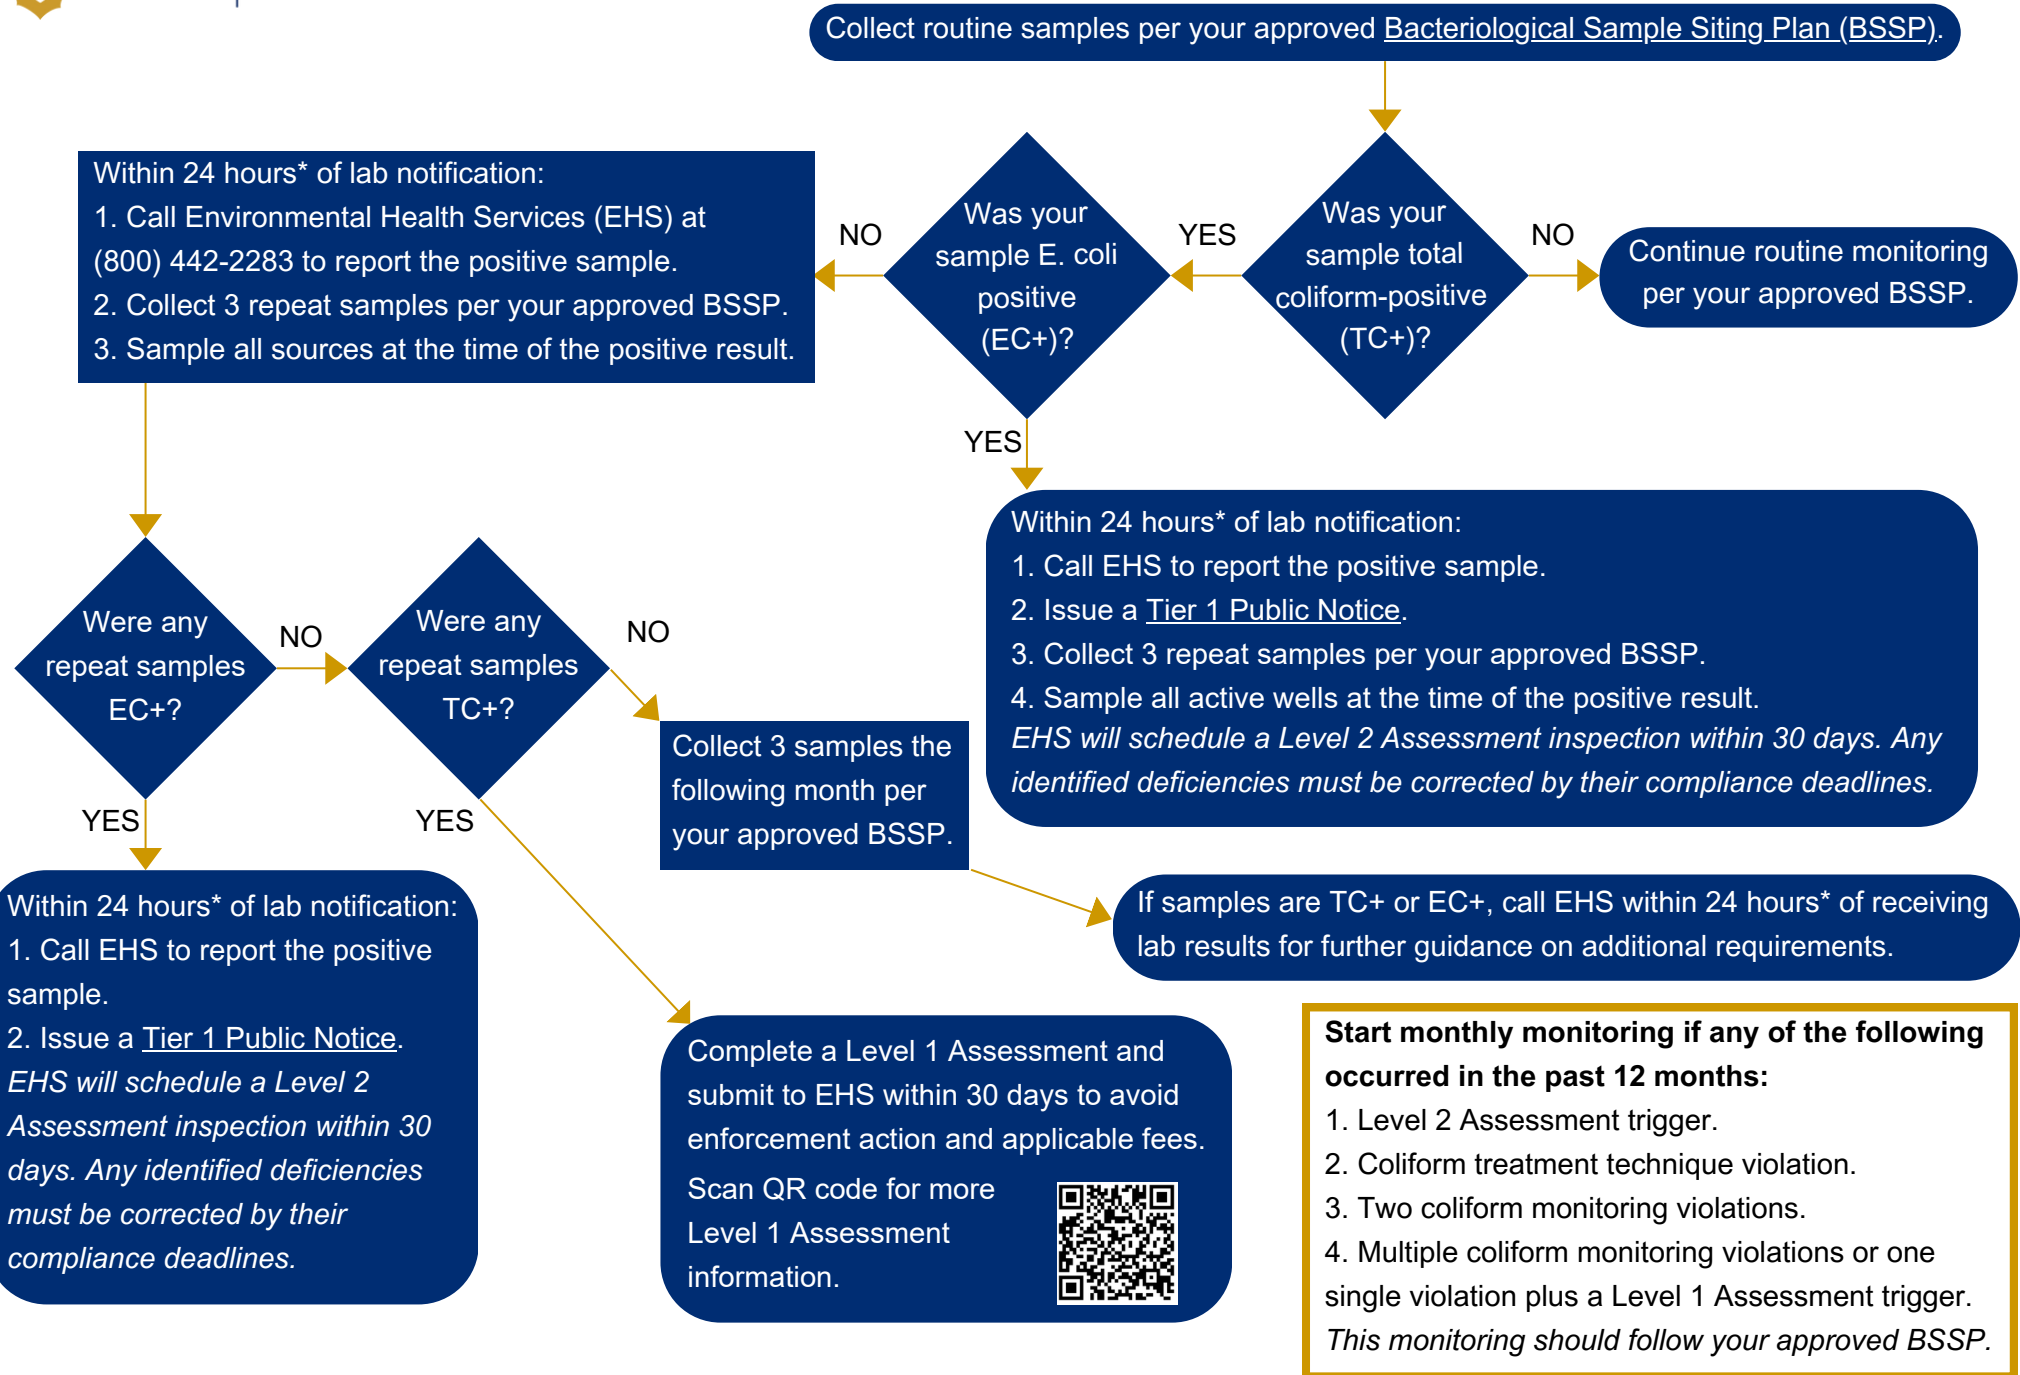

*Failure to take the correct number of repeat samples requires a Level 1 Assessment within 30 days. If the Water System cannot collect or deliver the samples to the lab within 24 hours, it must notify EHS at (800) 442-2283 within 24 hours.